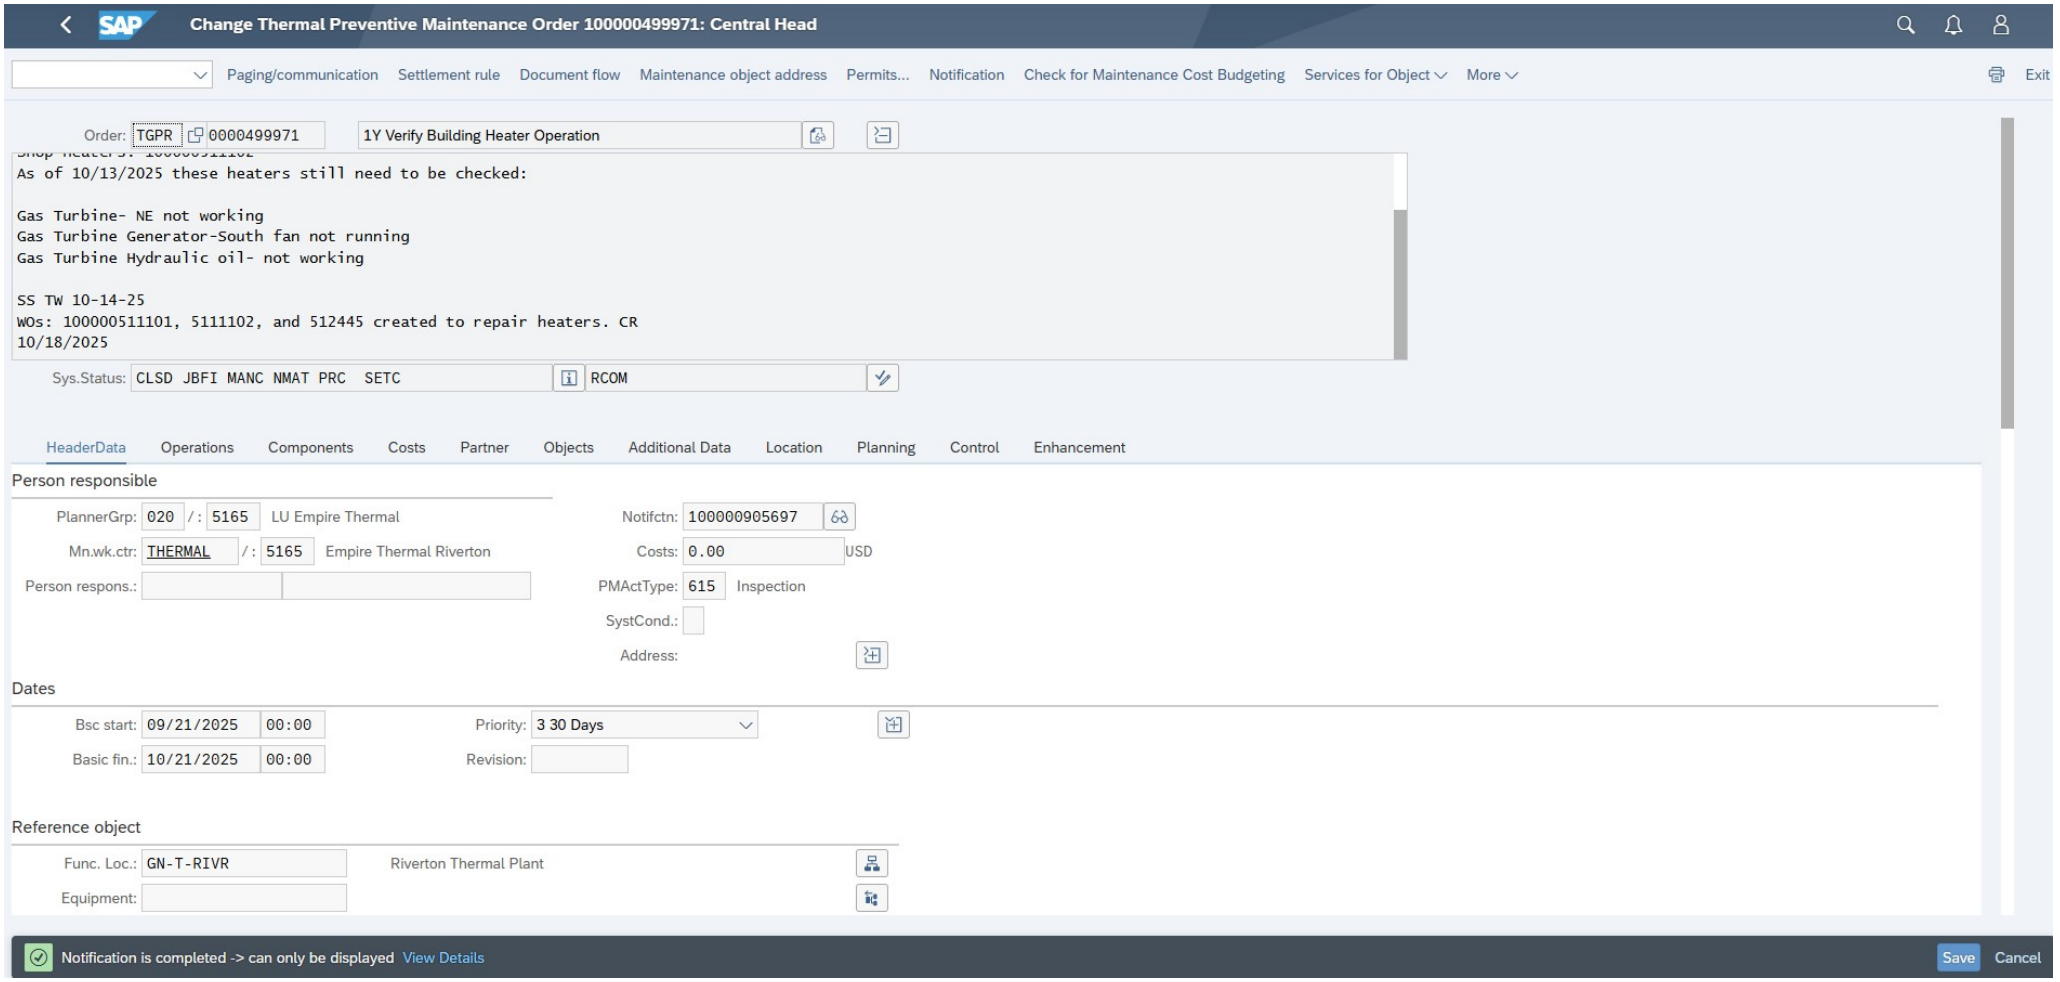
Change Thermal Preventive Maintenance Order 100000499971: Central Head
Paging/communication
Settlement rule
Document flow
Maintenance object address
Permits...
Notification
Check for Maintenance Cost Budgeting
Services for Object
More
Exit
Order: TGPR 0000499971
1Y Verify Building Heater Operation
As of 10/13/2025 these heaters still need to be checked:
Gas Turbine- NE not working
Gas Turbine Generator-South fan not running
Gas Turbine Hydraulic oil- not working
SS TW 10-14-25
WOs: 100000511101, 5111102, and 512445 created to repair heaters. CR
10/18/2025
Sys.Status: CLSD JBFI MANC NMAT PRC SETC
RCOM
HeaderData
Operations
Components
Costs
Partner
Objects
Additional Data
Location
Planning
Control
Enhancement
Person responsible
PlannerGrp: 020 / : 5165 LU Empire Thermal
Mn.wk.ctr: THERMAL / : 5165 Empire Thermal Riverton
Person respons.:
Notifctn: 100000905697
Costs: 0.00 USD
PMActType: 615 Inspection
SystCond.:
Address:
Dates
Bsc start: 09/21/2025 00:00
Basic fin.: 10/21/2025 00:00
Priority: 3 30 Days
Revision:
Reference object
Func. Loc.: GN-T-RIVR
Riverton Thermal Plant
Equipment:
Notification is completed -> can only be displayed
View Details
Save
Cancel